

Entwicklungs- und Prüflabor Holztechnologie GmbH · Zellescher Weg 24 · 01217 Dresden · Germany

Dr. Schutz GmbH
Frau Bettina Schaar
Produktentwicklung/Anwendungstechnik
Arbeitssicherheit
Steinbrinkweg 30
31840 Hessisch Oldendorf

Entwicklungs- und Prüflabor
Holztechnologie GmbH
Zellescher Weg 24
01217 Dresden

Tel.: +49 351 4662 0
Fax: +49 351 4662 211
info@eph-dresden.de
www.eph-dresden.de

Dresden, 23 January 2018
70-em/kle/bl

Test Report
Order No. 2716258_A1 / Part 2

Client: Dr. Schutz GmbH
Steinbrinksweg 30
31840 Hessisch Oldendorf

Date of order: 13 September 2017

Order: Test of the electrostatic properties of a resilient floor coverings coated with "ESD Medi Coat"

Contractor: EPH – Laboratory Surface Testing

Engineer in charge: Dipl.-Ing. Detlef Kleber



Dr.-Ing. Rico Emmler

Head of Laboratory Surface Testing

The test report contains 9 pages. Any duplication, even in part, requires written permission of EPH. These test results are exclusively related to the tested material.

1 Task

The laboratory EPH was ordered by Dr. Schutz GmbH to determine different surface resistances, constant resistance and body voltage of resilient floor with coverings coated with “ESD Medi Coat” in a walking test according to DIN EN 61340-4-1, DIN EN 61340-4-5 (without Walking test), DIN EN 61340-2-3 and ANSI/ESD STM7.1, ANSI/ESD S4.1. In addition, the suitability of the surface in EPA-areas should be tested according to DIN EN 61340-5-1/ ANSI S20.20 and explosive areas according to TRGS 727 or IEC TS 60079-32-1:2013.

This audit report replaces the report No. 2716258 / Part 2 of 12 December 2017.

2 Test Material

The client, Dr. Schutz GmbH, has sent 3 different samples of resilient floor with coverings coated with “ESD Medi Coat” (thickness $d = 2.5 \text{ mm}$).

Sample		Description by the producer / article	Measurement position
B1	B1.1	ESD Medi Coat, Sample1	left side
	B1.2		right side
B2	B2.1	ESD Medi Coat, Sample 2	left side
	-		-
B3	-	ESD Medi Coat, Sample 3	-

3 Requirements and measurement

3.1 Conditions for measurement

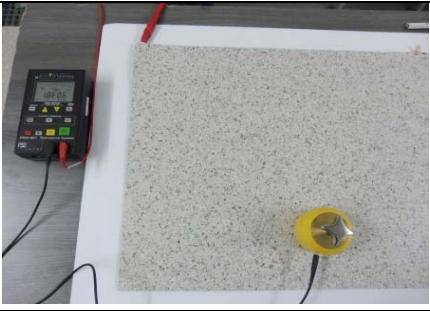



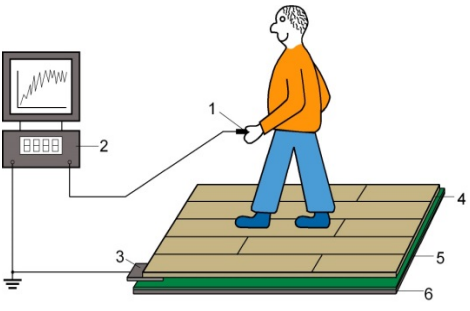
The test areas were conditioned 72 hours at drying atmosphere ($23 \text{ °C} \pm 2 \text{ K}$, $12 \% \pm 3 \%$ relative air humidity) and were tested in the same climate.

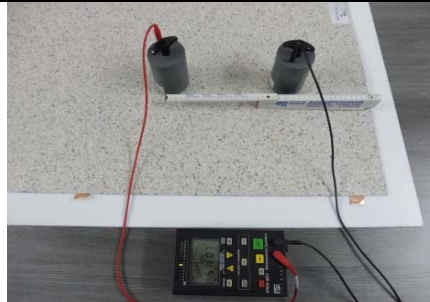

3.2 Measuring Instruments

The following resistance test devices were used: “PRS 801” (OF-27, fabricate PROSTAT) used measuring range $1 \times 10^0 \dots 2 \times 10^{13} \text{ Ohm}$, measuring voltage 10 V and 100 V (measurement uncertainty $< 5 \%$, lower than statistical variance of the measurement values).

3.3 Measurement setup

The following test was carried out according to different international norms:

Pos.	Properties	Measurement setup
1a	<p>R_{gp} resistance measured between an electrode placed on the surface of attest specimen and a groundable point fitted to the test specimen according to DIN EN 61340-4-1</p>	
1b	<p>R_{gp} (surface-) resistance measured between an electrode placed on the surface of attest specimen and a groundable point fitted to the test specimen according to ANSI/ESD STM7.1</p>	
2a	<p>R_{p-p} (surface-) resistance measured between two electrodes placed a specified distance apart on the same surface of a test specimen (distance $d = 300$ mm) according to DIN EN 61340-4-1</p>	
3a	<p>R_g resistance measured between an electrode placed on the surface of attest specimen (hand electrode tester) and a local (earth-) ground according to DIN EN 61340-4-5 measurement according to ANSI/ ESD STM97.1 are equivalent, measured values can be transmitted/ transferred</p>	
4a	<p>Walking test according to ANSI ESD STM97.2</p>	

Pos.	Properties	Measurement setup
5a	R_{p-p} (surface-) resistance measured between two electrodes placed a specified distance apart on the same surface of a test specimen (distance $d = 250$ mm) according to DIN EN 61340-2-3	
5b	R_{p-p} (surface-) resistance measured between two electrodes placed a specified distance apart on the same surface of a test specimen according to ANSI/ESD STM7.1 in line with ANSI/ESD S4.1 (see pos.2.a)	

The leakage resistance shall refer to an point with earthing properties (see picture pos. 1a). For the determination of resistance, earthing points on the backside according to the norms were used. There were appropriated self-adhesive copper stripes electrodes, featuring resistance $R < 0.001 \Omega$. The R_{gp} resistance refer to the point to point resistance (e.g. electrode gap according to EN 61340-4-1, $d = 300$ mm, see picture sample Pos. 2a). The R_g resistance refer to leakage resistance between a person body/ ESD (conducting) footwear and earthed floor covering. This resistance could be described as a system resistor (see picture pos. 3a).

The (yello) electrode with a diameter of 65 mm and weight 2.5 kg was used for the examination according to DIN EN 61340-4-1. The (gray) electrode with a diameter of 63.5 mm and weight 2.27 kg was used for measurements according to DIN EN 61340-2-3, ANSI/ESD STM7.1 und ANSI/ESD S4.1. In addition, the resistor value $R_x < 10^6 \Omega$ was measured at voltage $U_M = 10$ V. Higher resistance values $R_x > 10^6 \Omega$ were measured at voltage $U_M = 100$ V.

4 Results

Table 1: Determined resistance values according to EN 61340-4-1

Measurement	B1		B2	
	$U_M = 10 \text{ V}; 100 \text{ V}$			
	$R_{gp}[\Omega]$	$R_{p-p}[\Omega]$	$R_{gp}[\Omega]$	$R_{p-p}[\Omega]$
1	1,60E+06	2,30E+07	5,70E+06	2,60E+07
2	3,90E+06	2,40E+07	6,20E+06	8,00E+07
3	1,20E+06	5,60E+07	2,40E+06	1,10E+07
4	6,00E+06	4,20E+07	5,70E+06	3,40E+07
5	2,50E+06	1,50E+07	4,50E+06	1,90E+07
6	2,00E+06	5,20E+07	7,70E+06	1,50E+07
Geometric mean	2,5E+06	3,2E+07	5,0E+06	2,5E+07

Table 2: Determined leakage resistance (system resistor) according to EN 61340-4-5

Measurement	B1		B2	
	$U_M = 10 \text{ V}; 100 \text{ V}$			
	$R_g [\Omega]$			
1	2,10E+08		1,40E+08	
2	2,50E+08		1,00E+08	
3	2,50E+08		2,40E+08	
4	1,90E+08		2,60E+08	
5	1,90E+08		2,70E+08	
6	2,10E+08		2,70E+08	
Arithmetic mean	2,17E+08		2,13E+08	
	2,5E+08			

Table 3: Determined resistance values according to EN 61340-2-3

Measur.	B1.1		B1.2		B2.1	
$U_M = 10 \text{ V}; 100 \text{ V}$						
	$R_{gp}[\Omega]$	$R_{p-p}[\Omega]$	$R_{gp}[\Omega]$	$R_{p-p}[\Omega]$	$R_{gp}[\Omega]$	$R_{p-p}[\Omega]$
1	2,10E+06	1,70E+06	1,50E+06	1,40E+06	1,50E+06	1,30E+06
2	2,60E+06	1,70E+06	1,10E+06	3,40E+06	7,00E+05	1,50E+06
3	2,80E+08	1,10E+06	1,10E+06	2,40E+06	8,70E+05	1,10E+06
4	4,00E+06	2,00E+06	1,60E+06	1,10E+06	1,40E+06	3,70E+06
5	1,30E+07	1,10E+06	1,50E+06	1,70E+06	1,10E+06	3,50E+06
6	7,00E+08	1,30E+06	1,60E+05	2,00E+06	1,60E+06	1,20E+06
Arithmetic mean	1,7E+08	1,5E+06	1,2E+06	2,00E+06	1,1E+06	1,8E+06

Table 4: Determined resistance values according to ANSI/ESD S7.1

Measurement $U_M = 10\text{ V}; 100\text{ V}$		B1.1	
		$U_M = 10\text{ V}; 100\text{ V}$	
		R_{gp}/Ω	R_{gp}/Ω
Earthing point X	1	1,70E+06	6.8E+05
	2	1,90E+06	8.8E+05
	3	1,30E+06	6.8E+05
	4	1,30E+05	9.4E+06
	5	1,90E+06	1.0E+06
	6	1,20E+06	1.7E+06
Earthing point Y	1	1,90E+06	1.0E+06
	2	1,80E+06	8.2E+05
	3	1,40E+06	9.1E+05
	4	1,60E+05	8.4E+05
	5	9,10E+05	1.0E+06
	6	1,80E+06	1.4E+06
Arithmetic mean		1,3E+06	1,3E+06
Median		1,6E+06	1,6E+06
Maximum		1,9E+06	1,9E+06
Minimum		1,3E+05	1,3E+05

Table 5: Determined body voltage U_p [V] according to ANSI/ESD STM97.2 sample B (B3)

B3	Body voltage $I U_{pl}$ [V]																			
	1	2	3	4	5	6	7	8	9	10	1	2	3	4	5	6	7	8	9	10
	„Sink value“										„Crest value“									
AP 1	66	78	57	70	63	72	73	63	91	83	81	102	100	101	106	104	99	91	114	107
AP 2	47	67	55	63	50	64	70	55	82	81	79	101	90	96	101	104	90	91	109	102
AP 3	46	61	50	53	50	57	58	54	72	76	79	95	90	94	100	94	89	88	105	100
AP 4	45	52	49	47	44	51	55	51	65	73	77	94	90	93	99	92	78	87	103	99
AP 5	45	51	47	45	44	49	51	50	59	71	77	93	88	93	94	90	77	85	102	97
Arithmetic mean roundet to the tens	50	60	50	60	50	60	60	60	70	80	80	100	90	100	100	100	90	90	110	100
Total arithmetic mean	51										94									

Table 6: Determined resistance values according to ANSI/ESD S4.1 (Probe A 1.1)

Measure.	B1.1		B1.2		B2.1	
	U _M = 10 V; 100 V					
	R _{gp} [Ω]	R _{p-p} [Ω]	R _{gp} [Ω]	R _{gp} [Ω]	R _{p-p} [Ω]	R _{gp} [Ω]
X1	9,20E+05	1,20E+06	7,90E+05	9,20E+05	1,20E+06	7,90E+05
X2	1,90E+06	-	1,80E+06	1,90E+06	-	1,80E+06
X3	1,40E+06	-	1,30E+06	1,40E+06	-	1,30E+06
Y1	1,10E+06	2,50E+06	8,40E+05	1,10E+06	2,50E+06	8,40E+05
Y2	1,10E+06	-	1,90E+06	1,10E+06	-	1,90E+06
Y3	1,10E+06	-	1,70E+06	1,10E+06	-	1,70E+06
Median	1,10E+06	1,85E+06	1,50E+06	1,10E+06	1,85E+06	1,50E+06
Maximum	1,90E+06	2,50E+06	1,90E+06	1,90E+06	2,50E+06	1,90E+06
Minimum	9,20E+05	1,20E+06	7,90E+05	9,20E+05	1,20E+06	7,90E+05

5 Evaluation

The presented samples B were evaluated for the properties tested as follows:

ESD-area: Sample A - ESD MediCoat

Pos.	Properties	Measured values	Requirement/Assessment according to EN 61340-5-1	
			23 °C and 12 % rel.humidity	Result
1a	Resistance R_{gp} at the point with earthing properties according to EN 61340-4-1	$1.8 * 10^5 \Omega < R_{gp}$ $< 8.5 * 10^6 \Omega$	$R_{gp} < 10^9 \Omega$	fulfilled for floorings
2a	R_{p-p} resistance between two points according to DIN EN 61340-4-1	$7.3 * 10^6 \Omega < R_{p-p}$ $< 3.2 * 10^7 \Omega$	-	-
3a	Resistance R_g according to EN 61340-4-5*	$R_g = 7.4 * 10^7 \Omega *$	$R_g < 10^9 \Omega$	-
5a	R_{p-p} resistance between two points according to EN 61340-2-3	$5.2 * 10^5 \Omega < R_{gp}$ $< 3.3 * 10^6 \Omega$ $1.1 * 10^6 \Omega < R_{p-p}$ $< 1.0 * 10^7 \Omega$	$R_{gp} < 10^9 \Omega$ $R_{p-p} < 10^9 \Omega$	fulfilled for work surfaces/ storage racks

Pos.	Properties	Measured values	Requirement/Assessment according to ANSI S20.20	
			23 °C and 12 % rel.humidity	Result
1b	Resistance R_{gp} at the point with earthing properties according to ANSI/ESD STM7.1	$3.1 * 10^5 \Omega < R_{gp}$ $< 1.6 * 10^6 \Omega$	$R_{gp} < 10^9 \Omega$	fulfilled for floorings
2b	Surface resistance R_{p-p} between two points according to ANSI/ESD STM7.1	$6.8 * 10^5 \Omega < R_{p-p}$ $< 9.4 * 10^6 \Omega$	-	-
3b	System resistance R_g according to ANSI/ESD STM97.1	$R_g = 7.4 * 10^7 \Omega *$	$R_g < 10^9 \Omega$	fulfilled for personnel grounding
4b	Body voltage according to ANSI/ESD STM97.2	$23 V < U_M < 37 V$	$U < 100 V$	
5b	Resistance R_{p-p} according to ANSI/ESD S4.1	$2.1 * 10^5 \Omega < R_{gp}$ $< 1.3 * 10^6 \Omega$ $1.0 * 10^6 \Omega < R_{p-p}$ $< 1.7 * 10^6 \Omega$	$R_{gp} < 10^9 \Omega$ $R_{p-p} < 10^9 \Omega$	fulfilled for work surfaces/ storage racks

* Measurement according to ANSI/ ESD STM97.1 are equivalent, measured values can be transmitted/ transferred

Note explosion protection

In potentially explosive atmospheres requirement for floorings are described in "Technical Rules for Hazardous Substances" national standard (TRGS 727:2016; Germany) and international norm (IEC TS 60079-32-1:2013). Both regulations require for conductive resistance a value $R_E < 10^8 \Omega$. The required leakage resistance corresponds to the resistance R_{gp} of the presented samples to a point with earthing properties (see sample B: $R_{gp} < 5.0 * 10^6 \Omega$ - Table 1). The value determined at sample B fulfils this requirement. The test samples of resilient floor coverings coated with "ESD Medi Coat", which have been reported, are approved to be suitable for hazardous areas.



Dipl.-Ing. Detlef Kleber
Engineer in charge